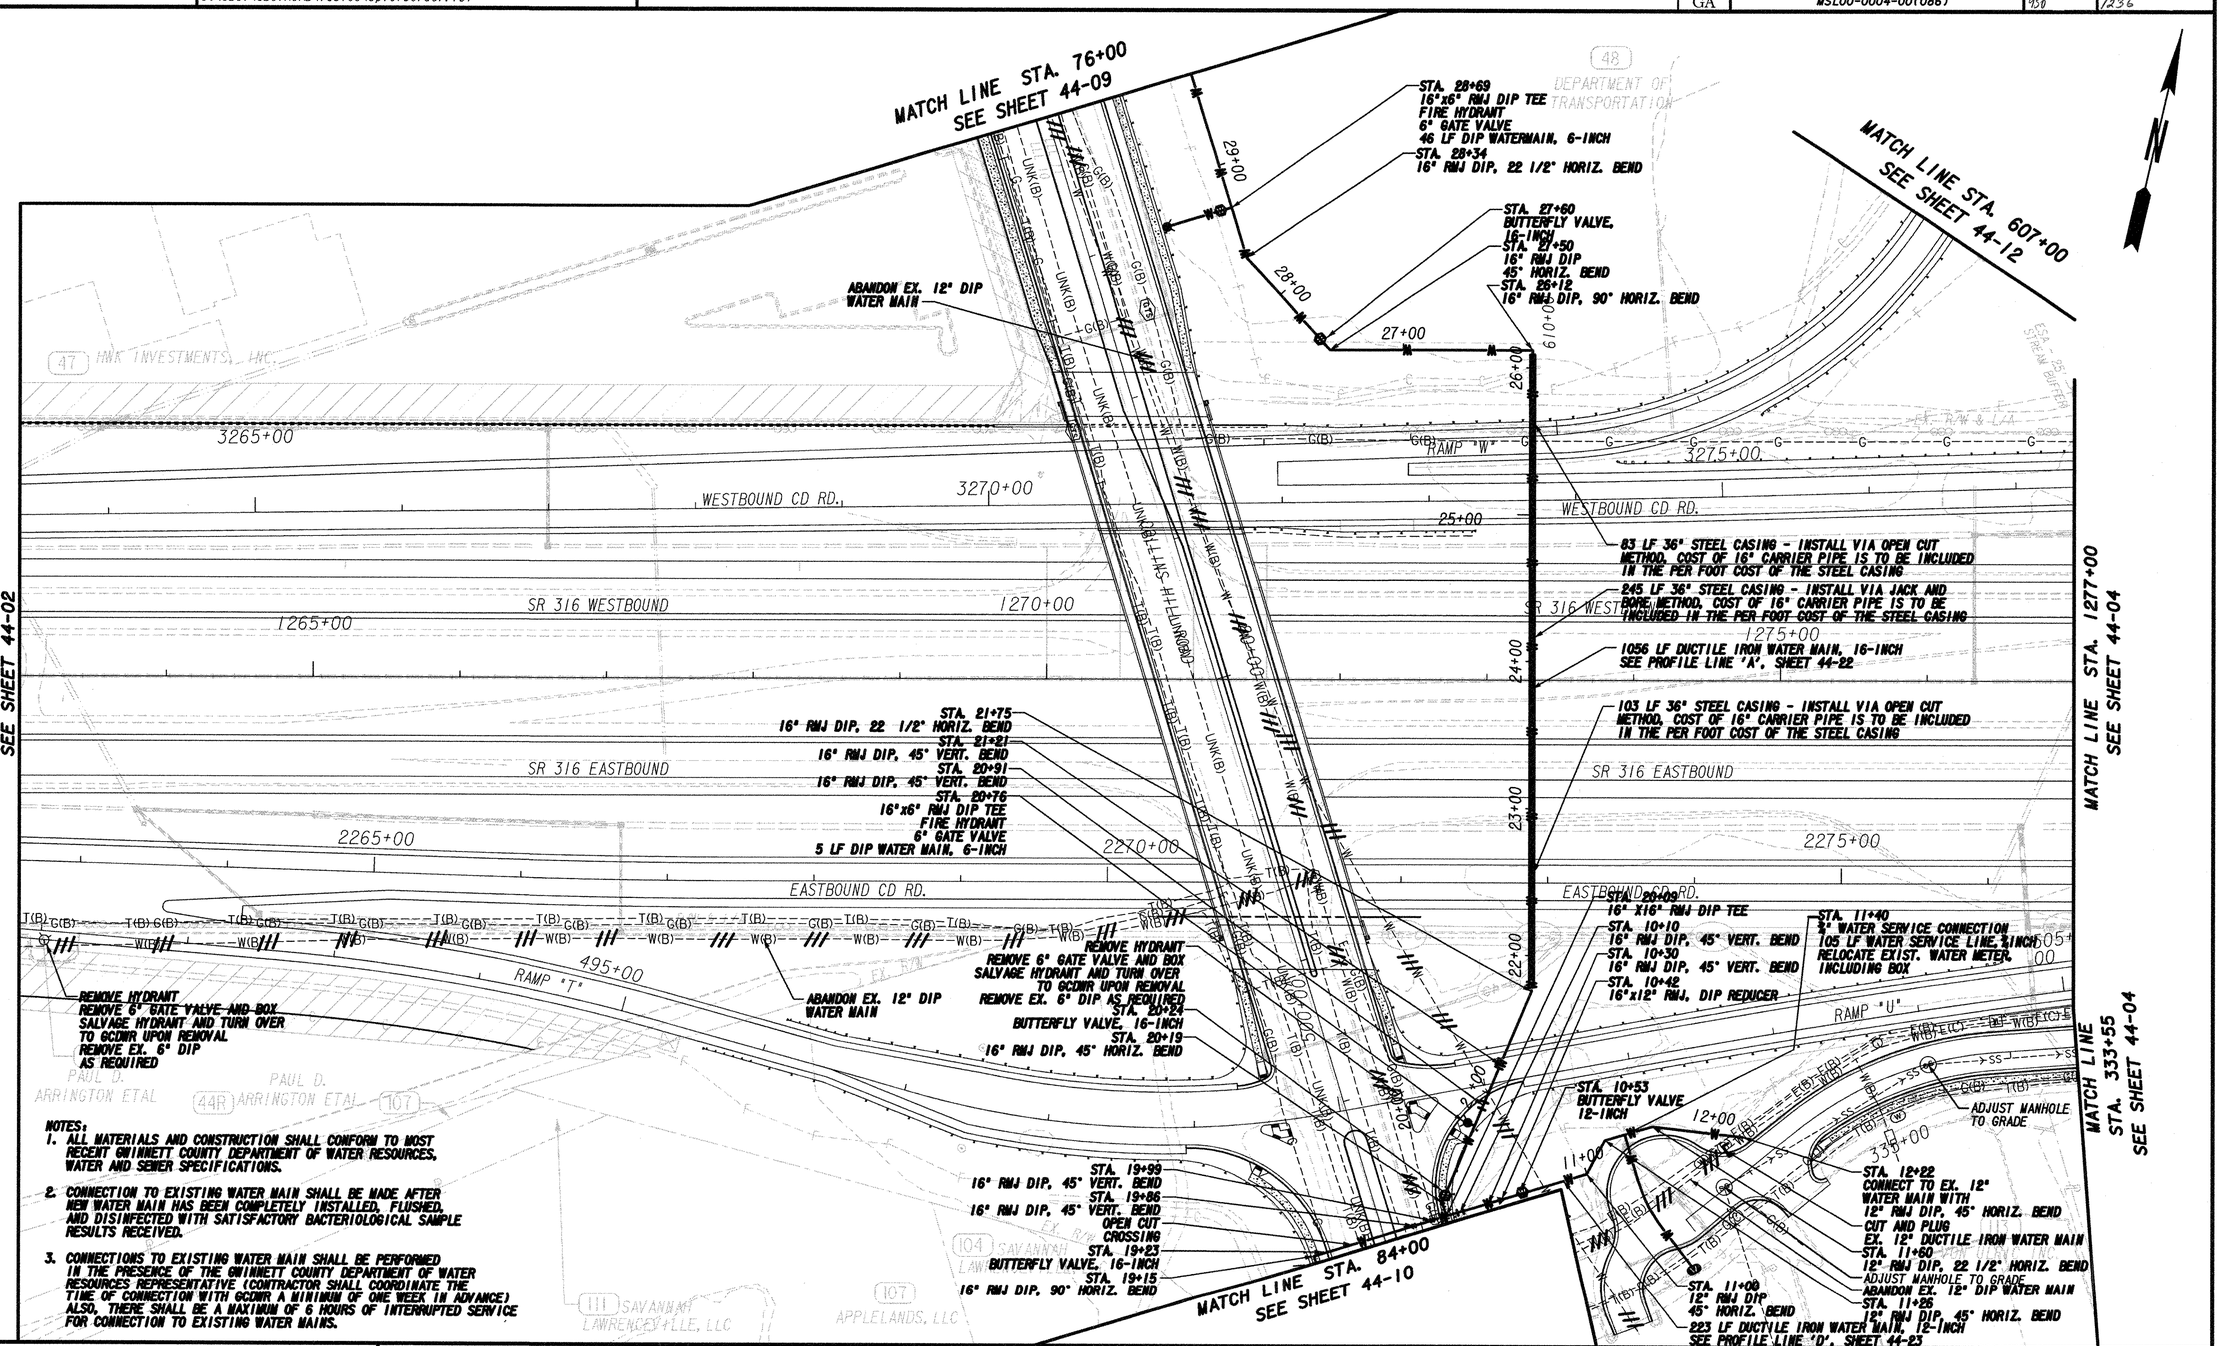

NOTES:

1. ALL MATERIALS AND CONSTRUCTION SHALL CONFORM TO MOST RECENT GWINNETT COUNTY DEPARTMENT OF WATER RESOURCES, WATER AND SEWER SPECIFICATIONS.
2. CONNECTION TO EXISTING WATER MAIN SHALL BE MADE AFTER NEW WATER MAIN HAS BEEN COMPLETELY INSTALLED, FLUSHED, AND DISINFECTED WITH SATISFACTORY BACTERIOLOGICAL SAMPLE RESULTS RECEIVED.
3. CONNECTIONS TO EXISTING WATER MAIN SHALL BE PERFORMED IN THE PRESENCE OF THE GWINNETT COUNTY DEPARTMENT OF WATER RESOURCES REPRESENTATIVE (CONTRACTOR SHALL COORDINATE THE TIME OF CONNECTION WITH GCDWR A MINIMUM OF ONE WEEK IN ADVANCE) ALSO, THERE SHALL BE A MAXIMUM OF 6 HOURS OF INTERRUPTED SERVICE FOR CONNECTION TO EXISTING WATER MAINS.

GWINNETT COUNTY DEPARTMENT
OF WATER RESOURCES
684 WINDER HIGHWAY
LAWRENCEVILLE, GEORGIA 30045
PHONE: (678) 376-6700

COLUMBIA ENGINEERING
2763 Meadow Church Road, Suite 100
Duluth, Georgia 30097
Phone: (770) 925-0357
Fax: (770) 925-0565

SCALE IN FEET
0 50 100 200

REVISION DATES

STATE OF GEORGIA
DEPARTMENT OF TRANSPORTATION
OFFICE: URBAN DESIGN

UTILITY RELOCATION PLANS

SR 316 FROM COLLINS HILL RD
TO HI-HOPE RD
STA. 1263+00 - STA. 1277+00

DRAWING No. 44-03