REQUIRED PAVEMENT

- (A) PLAIN PC CONCRETE PVMT, CL3 CONCRETE, 12 IN THK
- (B) RECYCLED ASPH CONCRETE 12.5mm SUPERPAVE, GP 2 ONLY, INCL BITUM (165 LBS/SY)
- (C) RECYCLED ASPH CONCRETE 19mm SUPERPAVE, GP 1 OR 2, INCL BITUM (220 LBS/SY)
- (D) RECYCLED ASPH CONCRETE 25mm SUPERPAVE, GP 1 OR 2, INCL BITUM (440 LBS/SY)
- (E) GR AGGR BASE CRS, 6 IN INCL MATL
- (F) GR AGGR BASE CRS, 12 IN INCL MATL
- (G) MILL ASPH CONC PVMT, 1½ IN DEPTH
- (H) RECYCLED ASPH CONCRETE PATCHING, INCL BITUM MATL & H LIME (AS REQUIRED)

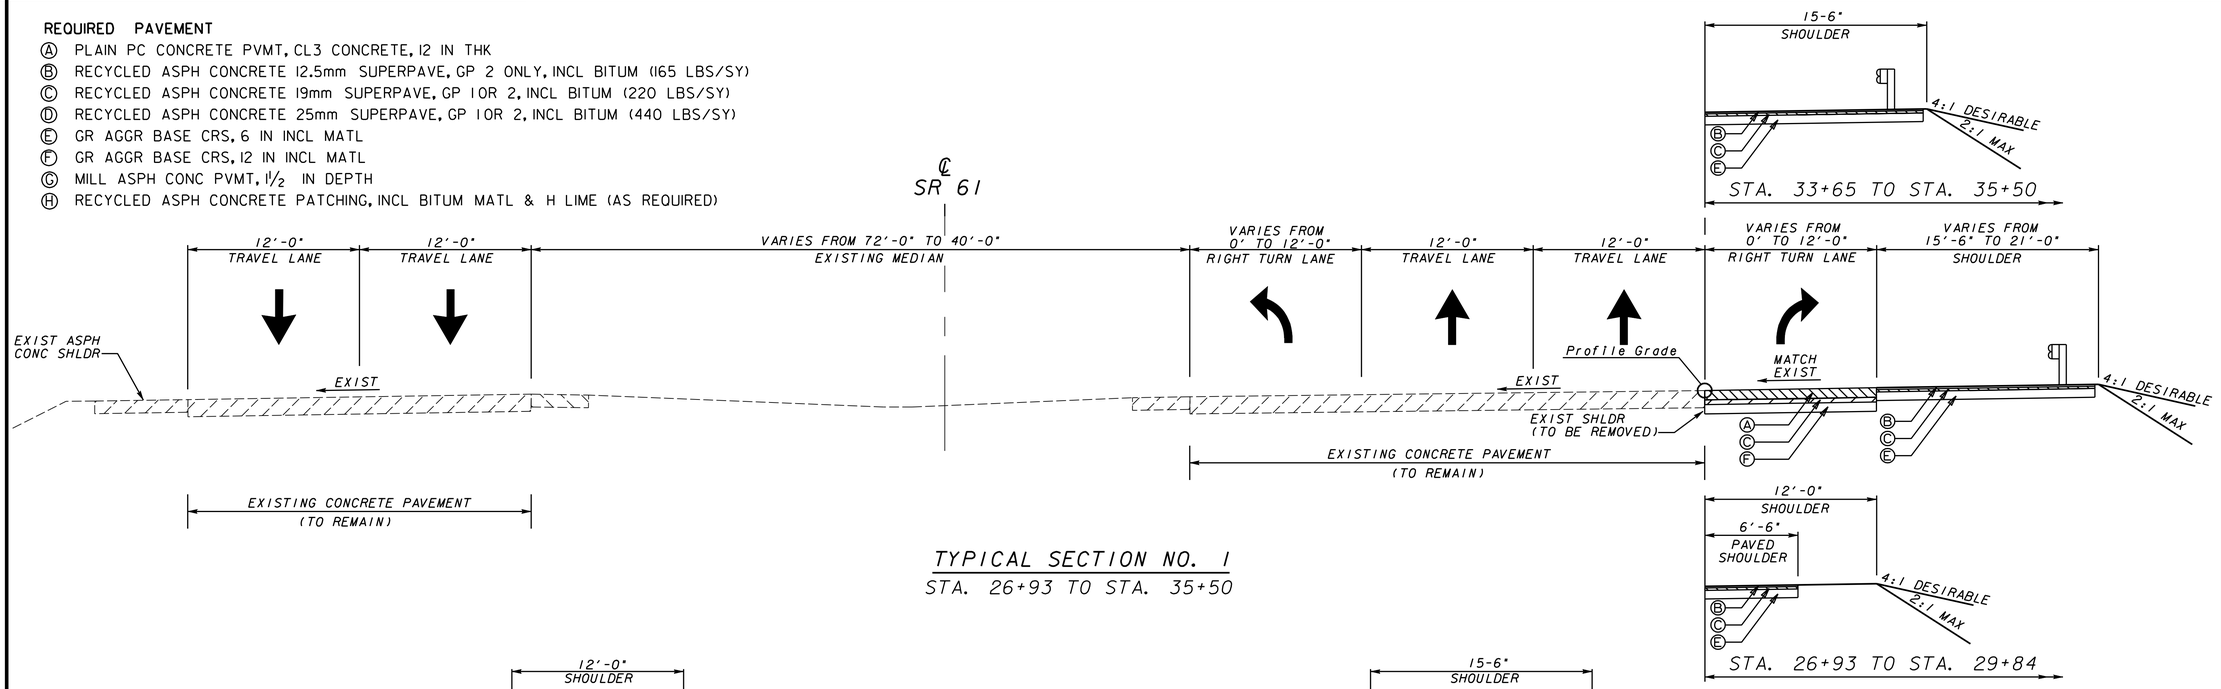

TYPICAL SECTION NO. 1

STA. 26+93 TO STA. 35+50

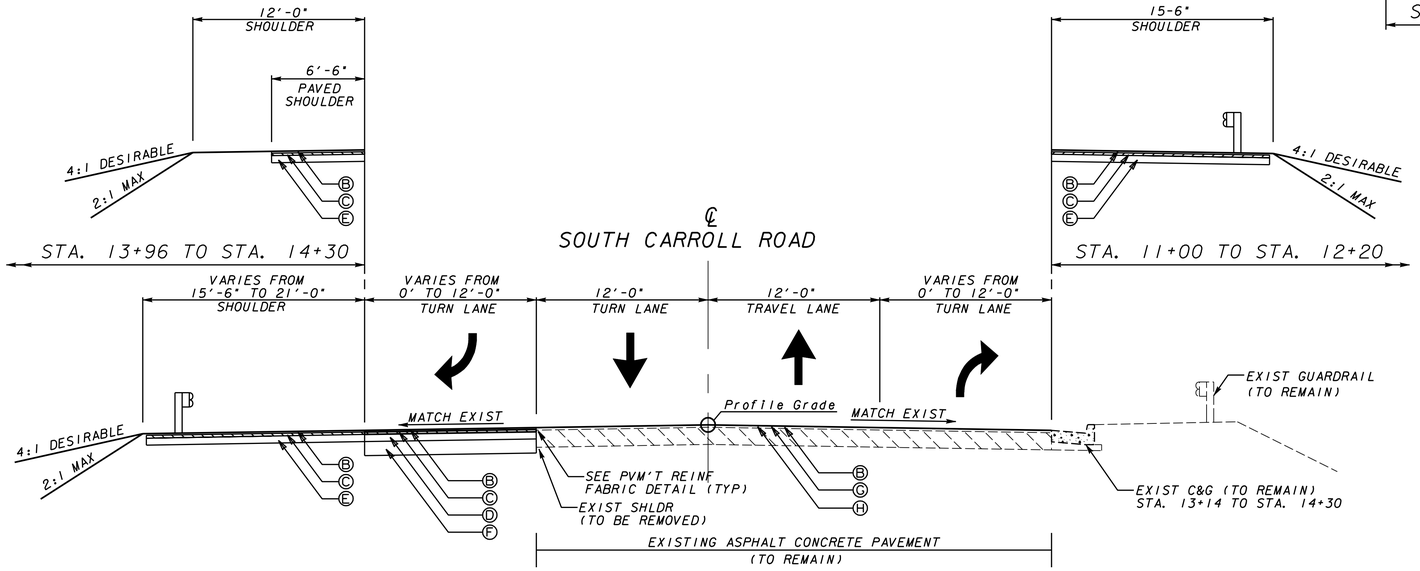

TYPICAL SECTION NO. 2

STA. 11+00 TO STA. 14+30

SLOPE CONTROLS		
SLOPE	CUT	FILL
4:1	0-6'	0-6'
2:1	OVER 6'	OVER 6'

•NOTE: ALL FILL SLOPES >4:1 AND >6' REQUIRE GUARDRAIL TO BE CONSISTENT WITH GA STD 4000W

Hatch Mott MacDonald
2550 Heritage Ct. SE, Suite 250 Atlanta, GA 30339

GRESHAM SMITH AND PARTNERS

NTS

REVISION DATES

STATE OF GEORGIA
DEPARTMENT OF TRANSPORTATION
PROGRAM DELIVERY

TYPICAL SECTIONS

SR 61 AT CS841/S CARROLL RD
SAFETY IMPROVEMENT PROJECT

DRAWING No. 5-001

GPLN