



# CONDUIT INSTALLATION DETAIL

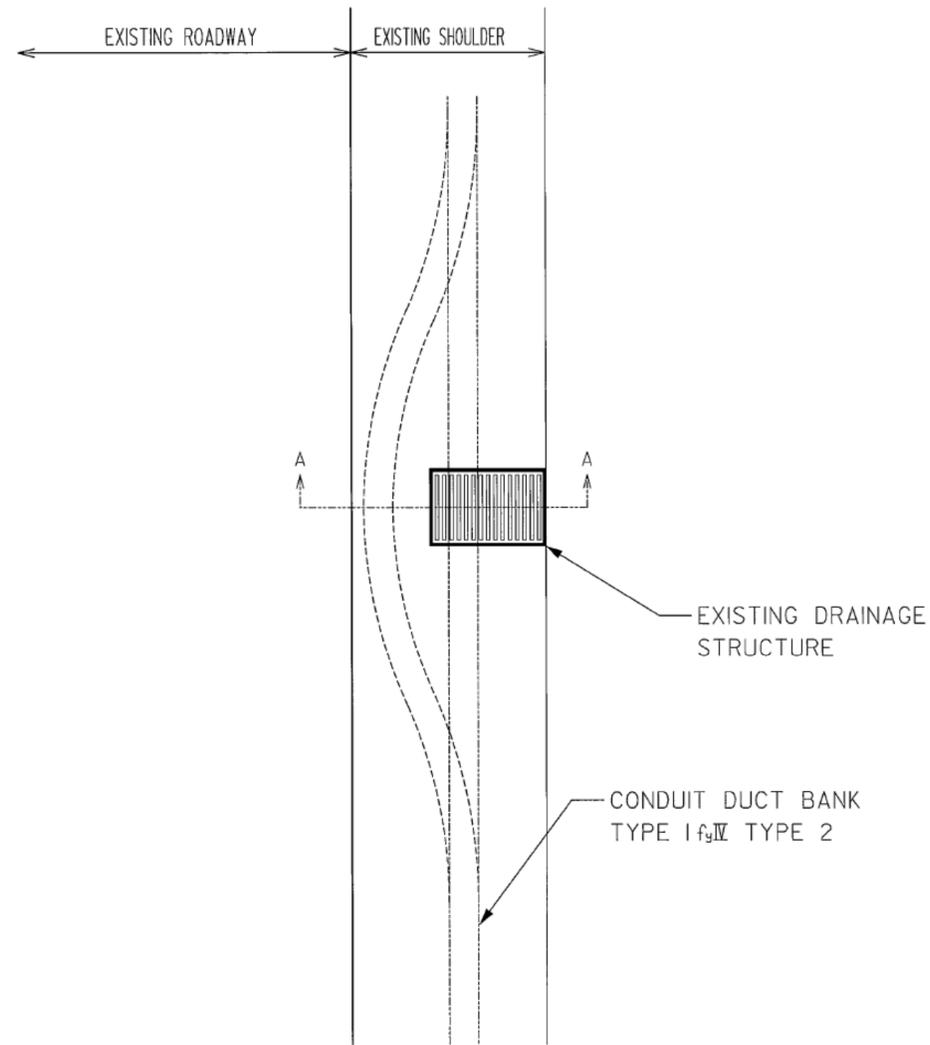

PLAN VIEW

- NOT TO SCALE -

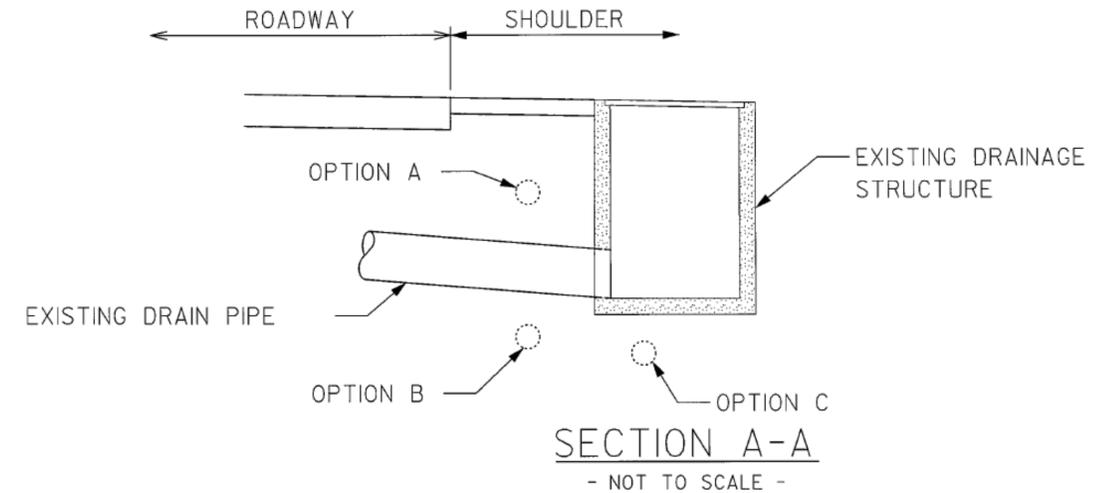

SECTION A-A

- NOT TO SCALE -

CONDUIT DUCT BANK INSTALLATION AT SHOULDER DRAINAGE STRUCTURE LOCATIONS

1. AT DRAINAGE STRUCTURE LOCATIONS WITHIN THE EXISTING SHOULDER, THE CONTRACTOR SHALL HAVE 3 OPTIONS FOR DUCT BANK INSTALLATION.
2. THE TOTAL COST FOR THE OPTION CHOSEN BY THE CONTRACTOR SHALL BE INCLUDED IN THE PRICE BID FOR CONDUIT DUCT BANK TYPE 1 OR TYPE 2.
3. OPTION A: TRENCH OR BORE OVER EXISTING DRAIN PIPE. CONTRACTOR MUST MAINTAIN A MINIMUM OF 18" DEPTH AND MINIMUM OF 6" CLEARANCE FROM EXISTING PIPE.  
 OPTION B: BORE UNDER EXISTING DRAIN PIPE, CONTRACTOR MUST MAINTAIN A MINIMUM 6" CLEARANCE UNDER DRAIN PIPE.  
 OPTION C: BORE UNDER EXISTING DRAINAGE STRUCTURE, CONTRACTOR MUST MAINTAIN A MINIMUM 12" CLEARANCE FROM THE BOTTOM OF THE STRUCTURE.

**GEORGIA**  
DEPARTMENT  
OF  
TRANSPORTATION

- NO SCALE -

REVISION DATES

09/01/2005

STATE OF GEORGIA  
DEPARTMENT OF TRANSPORTATION  
OFFICE: TRAFFIC SAFETY & DESIGN  
ATMS PLANS

CONDUIT INSTALLATION AT  
DRAINAGE STRUCTURES

ITS-09

DRAWING No.

40-007

...118-98-06-0000-0001-0001.dgn 4/17/2007 7:44:01 AM