

**NOTES**

- THE DIMENSIONS SHOWN ON THIS DRAWING ARE APPROXIMATE. THE CONTRACTOR SHALL OBTAIN THE ACTUAL DIMENSIONS FROM THE SERVICE POWER PEDESTAL MANUFACTURER.

**Service Power Pedestal Specifications**

The service power pedestals shall be provided at each service point and shall consist of all the components indicated on the single line diagrams.

The ratings shall be as follows:

Voltage rating: (120/240V, 1phase, 3wire)  
 Available short circuit current: 14,000A R.M.S. symmetrical  
 Current rating: See single line diagrams

The pedestal shall be of NEMA Type 3R rainproof construction and shall be UL listed as "Enclosed Industrial Control Equipment" (UL 508A). External construction shall comply with UL50 requirements and shall be of aluminum with light green #14672 Federal Specification 595 polyurethane industrial grade powder paint of 1.7 mil minimum thickness. Internal construction shall be G 90 galvanized steel with 1.7 mil minimum thickness polyurethane industrial grade powder coat paint. No fasteners except sealing screws shall be removable by external access. Hinges shall be stainless steel and of the continuous piano hinge type.

The pedestal mounting bolts shall not be externally accessible. The pedestal shall be offered with an optional base designed to be embedded in concrete in place of anchor bolts.

The service pedestal must have two separate isolated sections for utility termination and customer equipment.


The utility termination section must be pad-lockable and sealable and shall have a stainless steel handle provided on a lift-off cover. Sufficient clearance shall be provided for the indicated conduit for utility cables entrance. Utility landing lugs shall be UL listed and shall accommodate #6 - 350 kcmil conductors. Provide meter socket per GA Power requirements.

The customer compartment door shall be hinged on the left hand side. A stainless pad-lockable hasp provided to secure customer compartment. A door keeper provided to keep the door in an open position. A print pocket on the inside of the door shall hold all wiring schematics, circuit directories and instructions in a clear, weatherproof sleeve. Required UL labeling shall be located on the inside of the customer door. Distribution and control equipment shall be behind an internal dead-front door with a quarter-turn securing latch and be hinged to open more than 90 degrees. The dead-front door shall be hinged on the same side as the customer section door. All distribution and control equipment shall be factory wired using 600 volt wire sized to NEC and UL requirements.

Circuit breakers shall be permanently labeled with engraved name plates. The contactors for the switched section shall be controlled from 'Hand-Off-Auto' selector switches provided on the door. A photocell provided with each service pedestal shall control the contactor in the 'Auto' position of the selector switch. A surge suppressor Liebert catalog No. AH120S111RK shall be provided in each service power pedestal.

The service power pedestal shall be Milbank CP3B 'SL' series or approved equal, custom built for each service point in accordance with the single line diagrams.

See Detail-A, Sheet 25-01 for grounding information.

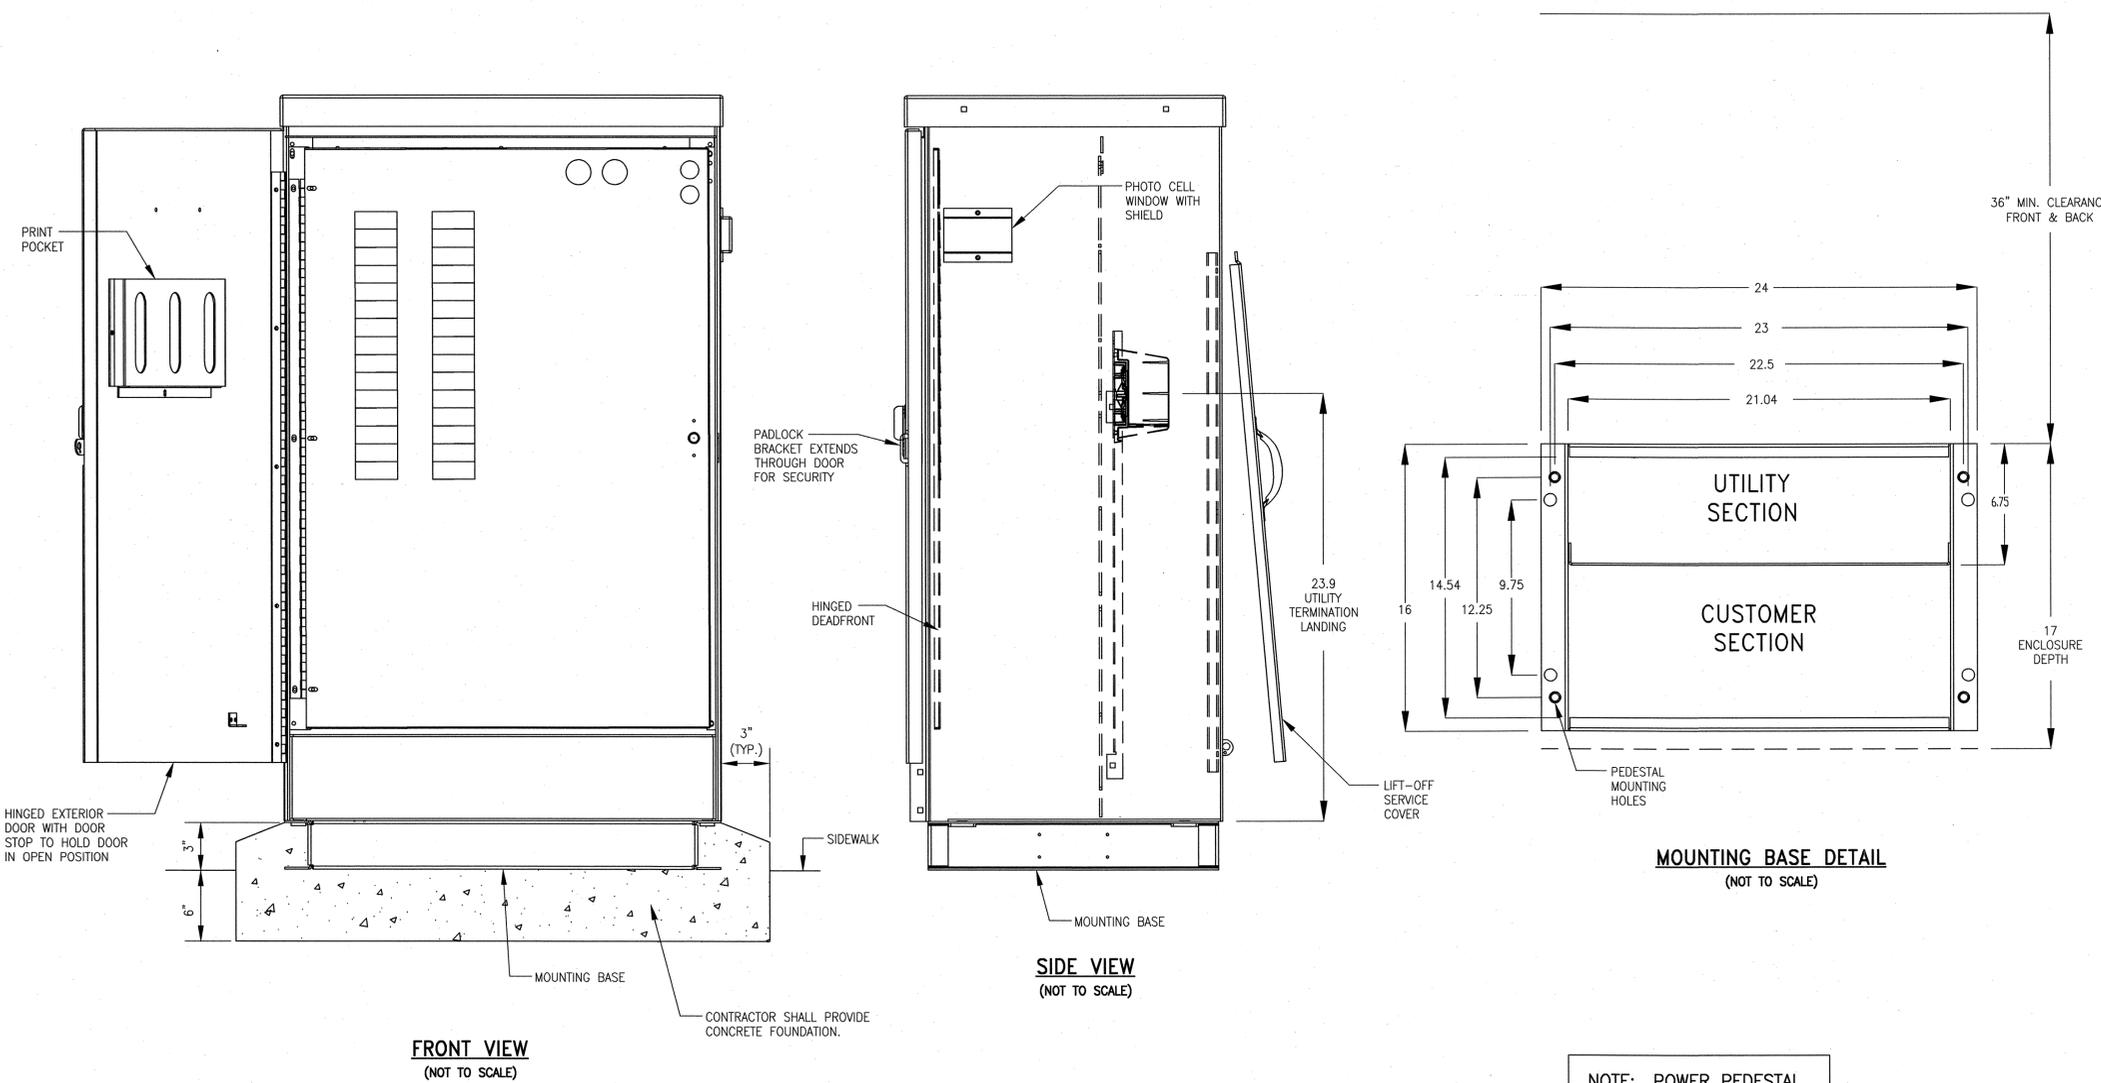

NOTE: POWER PEDESTAL INCLUDED IN MAIN SERVICE PICKUP POINT.

**SERVICE POWER PEDESTAL (NOTE 1)**

© 2008 ATLANTA CONSULTING ENGINEERS, INC. ALL RIGHTS RESERVED.

THESE CONSTRUCTION DOCUMENTS AND PERMITTED REPRODUCTIONS, IN WHOLE OR IN PART, ARE INSTRUMENTS OF SERVICE AND ARE THE SOLE PROPERTY OF ATLANTA CONSULTING ENGINEERS, INC. UNLESS OTHERWISE AGREED TO. THEY SHALL NOT BE REPRODUCED OR CONVEYED IN ANY MANNER NOR ARE THEY TO BE USED FOR ANY OTHER PROJECTS OTHER THAN THAT SPECIFICALLY INDICATED HEREIN WITHOUT WRITTEN PERMISSION FROM AND DUE COMPENSATION TO ATLANTA CONSULTING ENGINEERS, INC.

**ATLANTA CONSULTING ENGINEERS**  
 500 SUN VALLEY DRIVE  
 UNIT G2  
 ROSWELL, GEORGIA 30076  
 ba@ace.fdn.com  
 Tel: 678-205-2240  
 Fax: 678-205-2239

| REVISION DATES |  |
|----------------|--|
|                |  |
|                |  |
|                |  |
|                |  |
|                |  |

STATE OF GEORGIA  
 DEPARTMENT OF TRANSPORTATION  
 OFFICE OF ROAD DESIGN

Lighting Details - Power Service Pedestal  
 HPP00-0013-01(062) & 0010884  
 Buford Highway (SR13)  
 Sidewalk Improvements  
 Fulton/Dekalb County

DRAWING No.  
**25-29**