| STATE | PROJECT NUMBER | SHEET NO. | TOTAL SHEETS |
|---|---|---|---|
| GA | 0010925 | | |

RELEASED FOR CONSTRUCTION 03/08/2016

## NOTES:

1. 2" SCH 40 PVC 2#8 (CKT 2), 1#10G.
2. SPARE 2" SCH 40 PVC WITH PULLWIRE. CAP CONDUIT.
3. 2" SCH 40 PVC CONDUIT WITH PULLWIRE. STUB UP AND CAP CONDUIT.
4. CONTRACTOR TO RUN 2#8 (CKT-2), 1#10G CABLES FROM EJB ON NORTH SIDE OF BRIDGE VIA EXISTING GDOT CONDUIT UNDER BRIDGE TO EJB ON SIDE OF BRIDGE.
5. CONTRACTOR SHALL COORDINATE WITH GDOT PRIOR TO CONSTRUCTION.

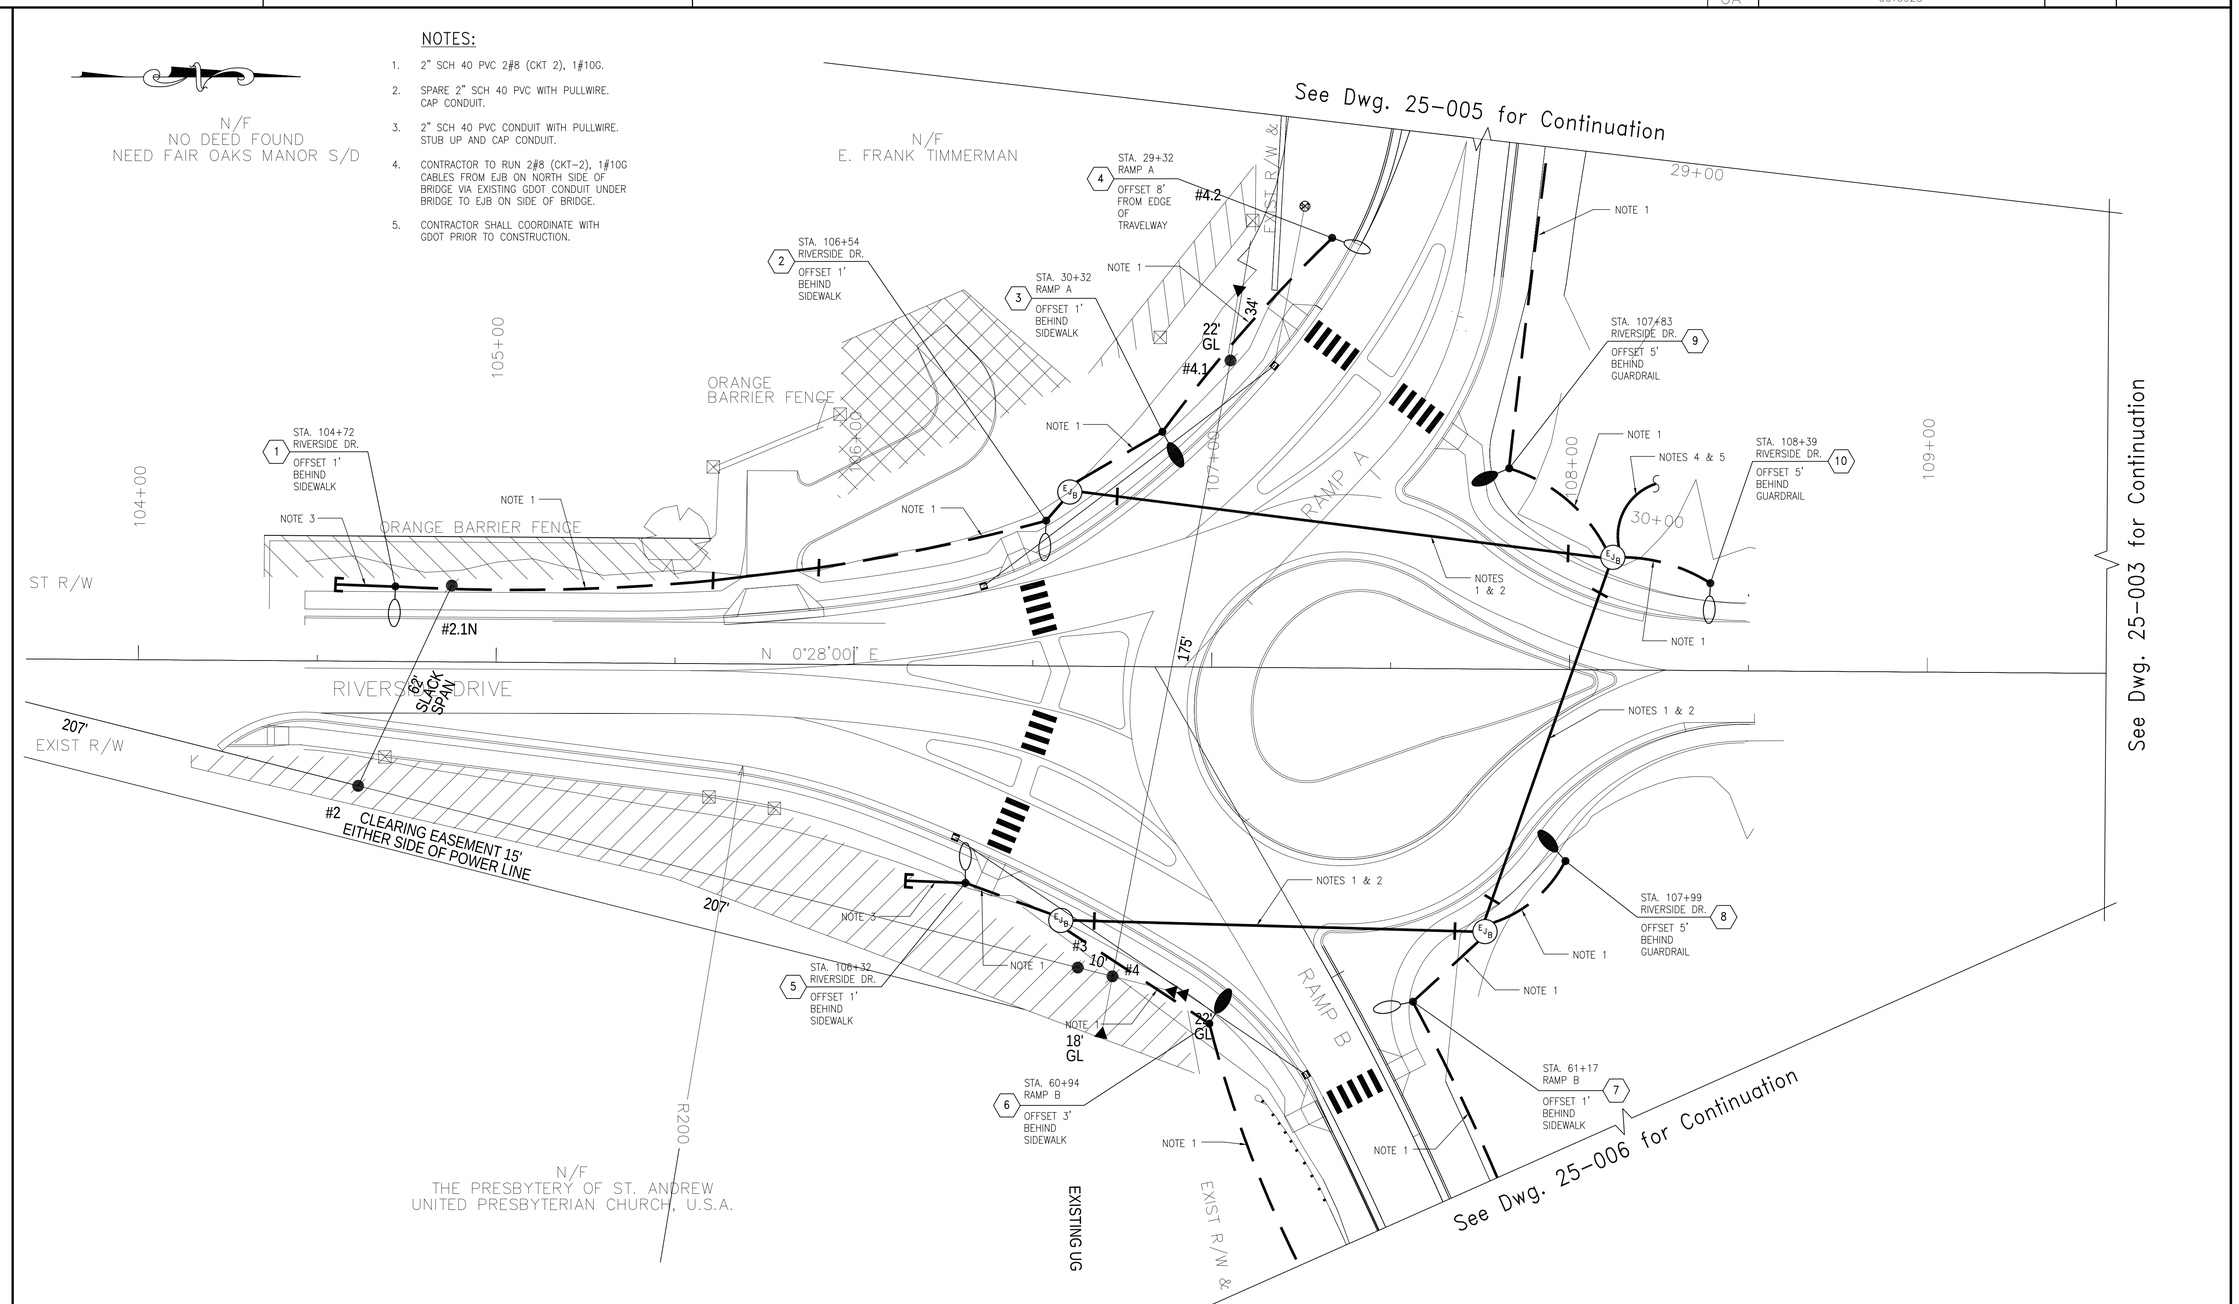


© 2015
ATLANTA CONSULTING ENGINEERS, INC.
ALL RIGHTS RESERVED

THESE CONSTRUCTION DOCUMENTS AND PERMITTED REPRODUCTIONS, IN WHOLE OR IN PART, ARE INSTRUMENTS OF SERVICE AND ARE THE SOLE PROPERTY OF ATLANTA CONSULTING ENGINEERS, INC. UNLESS OTHERWISE AGREED TO. THEY SHALL NOT BE REPRODUCED OR CONVEYED IN ANY MANNER NOR ARE THEY TO BE USED FOR ANY OTHER PROJECTS OTHER THAN THAT SPECIFICALLY INDICATED HEREIN WITHOUT WRITTEN PERMISSION FROM AND DUE COMPENSATION TO ATLANTA CONSULTING ENGINEERS, INC.

ATLANTA CONSULTING ENGINEERS
500 SUN VALLEY DRIVE
UNIT G2
ROSWELL, GEORGIA 30076
bal@atlconsengrs.com
Tel: 678-205-2240
Fax: 678-205-2239

SCALE IN FEET
0 20 40 80

INFRASTRUCTURE CONSULTING & ENGINEERING

REVISION DATES

STATE OF GEORGIA
DEPARTMENT OF TRANSPORTATION
OFFICE: INNOVATIVE DELIVERY

Lighting Layout

Riverside Drive at I-285
Interchange Improvements

DRAWING No.
25-002