


RELEASED FOR CONSTRUCTION 03/08/2016

NOTES:

1. CONTRACTOR SHALL COORDINATE WITH GEORGIA POWER FOR LOCATION OF POWER SERVICE.
2. CONTRACTOR SHALL INSTALL METER IN THE METER SOCKET PROVIDED WITH THE SERVICE POWER PEDESTAL IN ACCORDANCE WITH GEORGIA POWER.
3. REFER TO DWG. 25-012 FOR THE DETAILS AND SPECIFICATIONS FOR THE SERVICE POWER PEDESTAL.

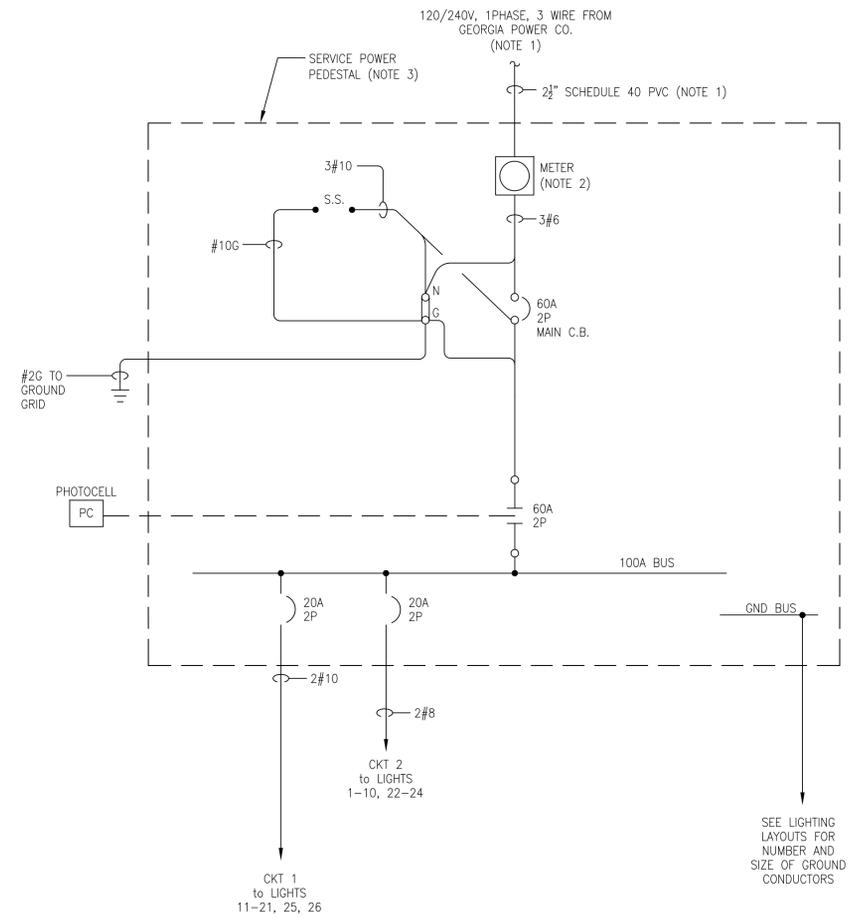

**SINGLE LINE DIAGRAM
SERVICE POINT**

© 2015
ATLANTA CONSULTING ENGINEERS, INC.
ALL RIGHTS RESERVED

THESE CONSTRUCTION DOCUMENTS AND PERMITTED REPRODUCTIONS, IN WHOLE OR IN PART, ARE INSTRUMENTS OF SERVICE AND ARE THE SOLE PROPERTY OF ATLANTA CONSULTING ENGINEERS, INC. UNLESS OTHERWISE AGREED TO, THEY SHALL NOT BE REPRODUCED OR CONVEYED IN ANY MANNER NOR ARE THEY TO BE USED FOR ANY OTHER PROJECTS OTHER THAN THAT SPECIFICALLY INDICATED HEREIN WITHOUT WRITTEN PERMISSION FROM AND DUE COMPENSATION TO ATLANTA CONSULTING ENGINEERS, INC.

ATLANTA CONSULTING ENGINEERS
500 SUN VALLEY DRIVE
UNIT G2
ROSWELL, GEORGIA 30076
ba@atlconsengrs.com
Tel: 678-205-2240
Fax: 678-205-2239

INFRASTRUCTURE CONSULTING & ENGINEERING

REVISION DATES

STATE OF GEORGIA
DEPARTMENT OF TRANSPORTATION
OFFICE: INNOVATIVE DELIVERY

Single Line Diagram

Riverside Drive at I-285
Interchange Improvements

DRAWING No.
25-009