

PROJECT SPECIFIC NOTES

- THIS PROJECT WILL REQUIRE A NOTICE OF INTENT.
- THERE IS NOT A SUITABLE SITE WITHIN THE PROJECT LIMITS FOR BURIAL OF THE EXISTING BRIDGE OR CONSTRUCTION DEBRIS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR FINDING A SUITABLE SITE AT NO ADDITIONAL COST TO THE DEPARTMENT. ALL BORROW AND WASTE SITES SHALL BE SUBJECT TO PRIOR APPROVAL OF GDOT ENVIRONMENTALISTS.
- THE DISTRICT 2 TRAFFIC ENGINEER SHALL BE CONTACTED AT 478-552-4613 AT LEAST TWO WEEKS PRIOR TO INSTALLING ANY FINAL PAVEMENT MARKINGS.
- ALL EXISTING PIPES SHALL BE REMOVED UNLESS OTHERWISE NOTED ON THE PLANS. PAYMENT SHALL BE MADE UNDER GRADING COMPLETE.
- ALL BORROW AND WASTE SITES FOR THIS PROJECT SHALL BE ENVIRONMENTALLY APPROVED PRIOR TO CONSTRUCTION ACTIVITIES. ALL COMMON FILL OR EXCESS MATERIAL DISPOSED OUTSIDE THE PROJECT RIGHT OF WAY SHALL BE PLACED IN EITHER A PERMITTED SOLID WASTE FACILITY, A PERMITTED INERT WASTE LANDFILL, OR IN AN ENGINEERED FILL. SEE SECTION 201 OF THE STANDARD SPECIFICATIONS AND SUPPLEMENTS THERETO FOR ADDITIONAL INFORMATION.

THE FOLLOWING UTILITIES HAVE FACILITIES WHICH MAY CONFLICT WITH THIS PROJECT:
ELECTRIC

GEORGIA POWER COMPANY (DISTRIBUTION)

TELEPHONE



AT&T GEORGIA

COLUMBIA COUNTY - BROADBAND

WATER

COLUMBIA COUNTY WATER AND SEWER

RESOURCE NAME/TYPE	ADDITIONAL INFORMATION	SIDE	CONSTRUCTION ACTIVITY	PERMITTED ACTIVITY	CONTROLLING CRITERIA	SPECIAL PROVISION?	COMMENTS INCLUDING ANY PERMIT EXPIRATION DATES
A-1	OPEN WATER (OWN KEG CREEK)	CL	BRIDGE CONSTRUCTION	No work allowed w/in buffer w/o variance	None at this time	None at this time	None at this time
A-2	OWN BUFFER	CL	BRIDGE CONSTRUCTION	No work allowed w/in buffer w/o variance	None at this time	None at this time	None at this time
A-3	MIGRATORY BIRDS	--	BRIDGE CONSTRUCTION	No work allowed w/in buffer w/o variance	None at this time	SP 107.23 G	None at this time

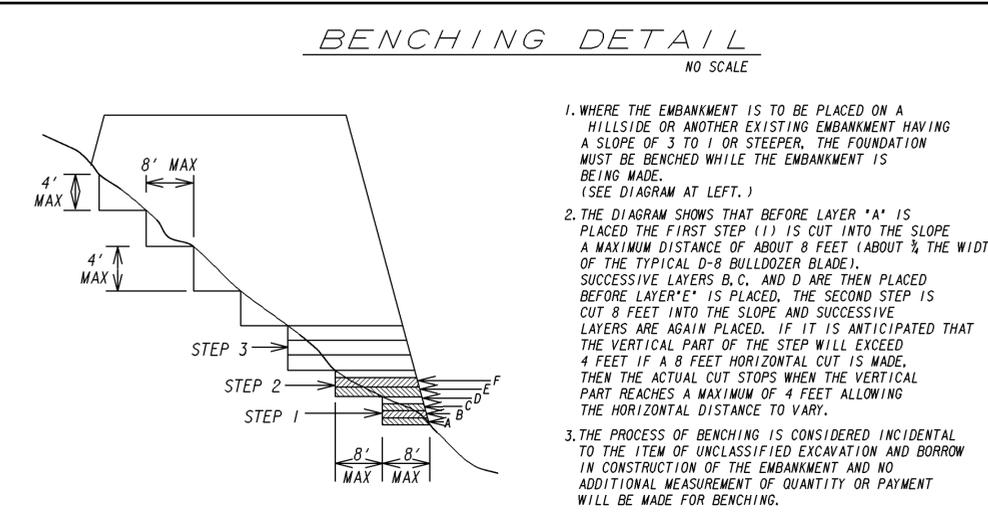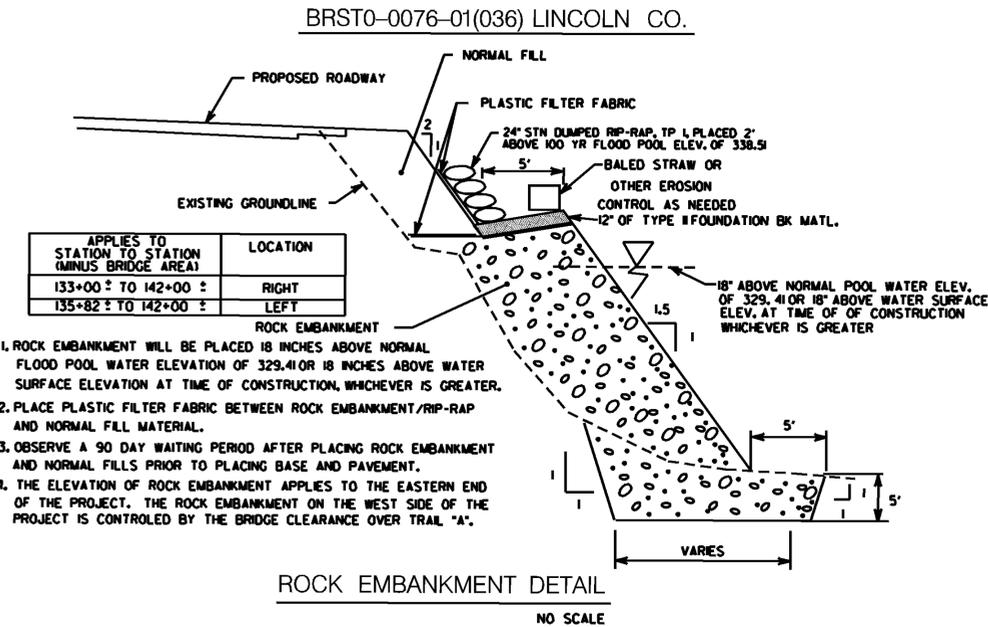

GENERAL NOTES

Utilities Protection Center, Inc

Know what's below.
Call before you dig.

TYPE OF PIPE INSTALLATION	CORRUGATED STEEL AASHTO M-36	CORRUGATED ALUMINUM AASHTO M-196		PLASTIC			
		ALUMINUM COATED (TYPE 2) CORR. STEEL	PLAIN ZINC COATED	PLAIN UNCOATED ALUMINUM	CORR. POLY-ETHYLENE SMOOTHED LINED AASHTO M-252	CORR. POLY-ETHYLENE SMOOTHED LINED AASHTO M-294 TYPE 'S'	POLY VINYL CHLORIDE (PVC) PROFILE WALL AASHTO M-304
LONGITUDINAL INTERSTATE AND TRAVEL BEARING	X						
LONGITUDINAL NON-INTERSTATE AND NON-TRAVEL BEARING	X	X	X	X	X	X	X
CROSS DRAIN	ADT < 250	X	X	X	X	X	X
	250 < ADT < 1500	X	X*	X	X	X	X
	1500 < ADT < 15000	X			X	X	X
GRADE > 10%	ADT > 15000	X					
	ADT < 250		X	X	X	X	X
ADT > 250			X	X	X	X	
SIDE DRAIN	X	X	X	X	X	X	X
PERMANENT SLOPE DRAIN		X	X	X	X	X	X
PERFORATED UNDERDRAIN		X	X	X	X	X	X

* THIS PIPE CAN BE USED IF THE ADDITION OF TYPE "B" COATING (AASHTO M-190, HALF BITUMINOUS COATED WITH PAVED INVERT) IS UTILIZED.

- NOTES:
- ALLOWABLE MATERIALS ARE INDICATED BY AN "X".
 - STRUCTURAL REQUIREMENTS OF STORM DRAIN PIPE WILL BE IN ACCORDANCE WITH GEORGIA STANDARD 1030-D OR 1030-P, WHICHEVER IS APPLICABLE, AND THE STANDARD SPECIFICATIONS.
 - GRADED AGGREGATE BACKFILL SHALL BE USED IN CROSS DRAIN APPLICATIONS FOR ALL PLASTIC PIPES (AASHTO M-294, HDPE PIPE, AASHTO M-304, PVC PIPE, ASTM F-949 PIPE) REVISED 10-04-05
 - TEMPORARY PIPE CAN BE CMP, PLASTIC OR CONCRETE.
 - USE THE ALLOWABLE PIPE CHART UNLESS OTHERWISE NOTED ON THE PLANS.
 - THE CONTRACTOR SHALL PROVIDE ADDITIONAL STORM SEWER CAPACITY CALCULATIONS IF A PIPE MATERIAL OTHER THAN CONCRETE IS SELECTED.

GEORGIA DEPARTMENT OF TRANSPORTATION	REVISION DATES	STATE OF GEORGIA DEPARTMENT OF TRANSPORTATION OFFICE: D2 - TENNILLE
		GENERAL NOTES
		BRST0-0076-01(037) PI NO. 232305
		DRAWING No. 04-001