

SEE PLANS FOR SUPERELEVATION RATES AND TRANSITION POINTS


TYPICAL SECTION NO. 5
 STA. 62+30 TO STA. 64+50
 STA. 113+00 TO STA. 115+50

NOTE: ALL EXISTING PAVEMENT WITHIN STATION RANGES SHOWN TO BE REMOVED

- * SEE PLANS FOR RELATION OF MEDIAN TO CONSTRUCTION CENTERLINE
- ** VARIABLE PAVEMENT WIDTH CAN BE LEFT OR RIGHT OF CONSTRUCTION CENTERLINE. SEE PLANS FOR LOCATION.
- *** SPACE BETWEEN CURBS TO BE GRASSED FOR WIDER MEDIANS. IN NARROW MEDIANS, SPACE BETWEEN CURBS TO BE FILLED WITH PLAIN CONCRETE MEDIAN PAVEMENT, 4" THICKNESS. THIS WILL OCCUR WHENEVER DISTANCE BETWEEN CURBS IS 5 FEET OR LESS. SEE PLANS FOR EXACT LOCATIONS.

PAVEMENT COURSE LEGEND

- (A) 165 LB/YD² RECYCLED ASPHALTIC CONCRETE, 12.5mm SUPERPAVE MIX DESIGN LEVEL B
- (B) 220 LB/YD² RECYCLED ASPHALTIC CONCRETE, 19mm SUPERPAVE MIX DESIGN LEVEL B
- (C) 330 LB/YD² RECYCLED ASPHALTIC CONCRETE, 25mm SUPERPAVE, MIX DESIGN LEVEL A
- (D) 8 INCHES GRADED AGGREGATE BASE COURSE PAID FOR BY SQUARE YARD
- (E) GA STD 9032-B 8"x30" CONCRETE CURB AND GUTTER, TYPE 7 FACE
- (F) GA STD 9032-B 8"x30" CONCRETE CURB AND GUTTER, TYPE 2 FACE
- (G) CONCRETE SIDEWALK, GA DETAIL A-3, 4" THICKNESS
- (H) RECYCLED ASPHALTIC CONCRETE LEVELING AS REQUIRED TO MEET GRADE REQUIREMENTS
- (I) PAVEMENT REINFORCING FABRIC, SEE DETAIL ON SHEET 5
- (J) PLAIN CONCRETE MEDIAN PAVEMENT, 4" THICKNESS, GA STD. 9032B

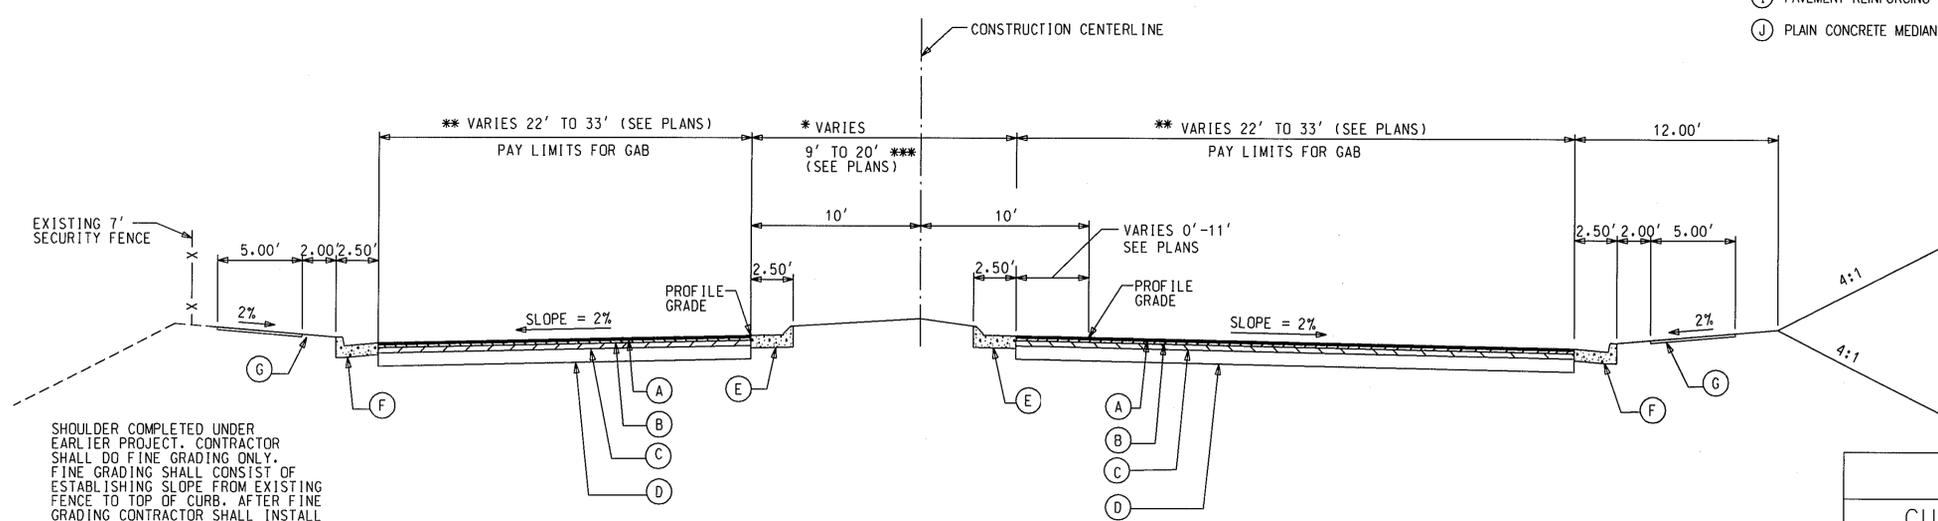

SHOULDER COMPLETED UNDER EARLIER PROJECT. CONTRACTOR SHALL DO FINE GRADING ONLY. FINE GRADING SHALL CONSIST OF ESTABLISHING SLOPE FROM EXISTING FENCE TO TOP OF CURB. AFTER FINE GRADING CONTRACTOR SHALL INSTALL SIDEWALK, DRESS AND GRASS.

TYPICAL SECTION NO. 6
 STA. 99+80 TO STA. 101+50

NOTE: ALL EXISTING PAVEMENT WITHIN STATION RANGES SHOWN TO BE REMOVED

- * SEE PLANS FOR RELATION OF MEDIAN TO CONSTRUCTION CENTERLINE
- ** VARIABLE PAVEMENT WIDTH CAN BE LEFT OR RIGHT OF CONSTRUCTION CENTERLINE. SEE PLANS FOR LOCATION.
- *** SPACE BETWEEN CURBS TO BE GRASSED FOR WIDER MEDIANS. IN NARROW MEDIANS, SPACE BETWEEN CURBS TO BE FILLED WITH PLAIN CONCRETE MEDIAN PAVEMENT, 4" THICKNESS. THIS WILL OCCUR WHENEVER DISTANCE BETWEEN CURBS IS 5 FEET OR LESS. SEE PLANS FOR EXACT LOCATIONS.

SEE SHEET 9 FOR ALLOWABLE RANGES TABLE

| SLOPE CONTROL | | | | | |
|---------------|------------|-----------|----------------|------------|-----------|
| CUT SECTION | | | FILL SECTION | | |
| DEPTH OF CUT | FRONTSLOPE | BACKSLOPE | HEIGHT OF FILL | FRONTSLOPE | BACKSLOPE |
| 0FT-10FT | 4:1 | N/A | 0FT-10FT | 4:1 | NA |
| OVER 10FT | 4:1 | N/A | OVER 10FT | 4:1 | NA |

NOTE: TYPICAL SECTIONS ARE NOT TO SCALE