STATE	PROJECT NUMBER	SHEET NO.	TOTAL SHEETS
GA.	NHS-M000-00(438)	83	

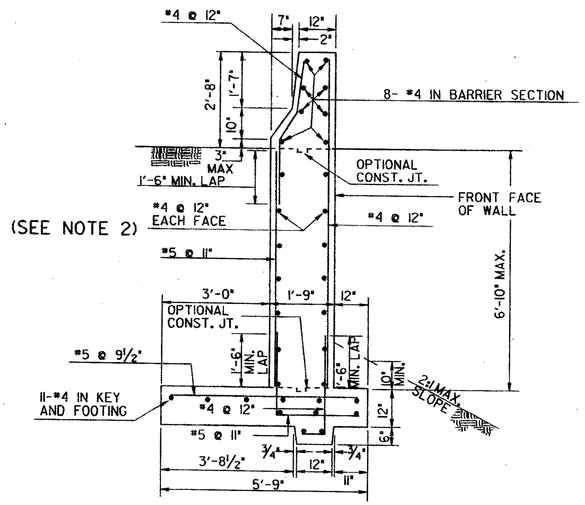

TYPE 2-A SIDE BARRIER

RED'D SOIL BEARING CAPACITY	
TYPE	CAPACITY, TONS/SF
2-A	1.25
2-B	1.25
2-C	1.5
2	1.0

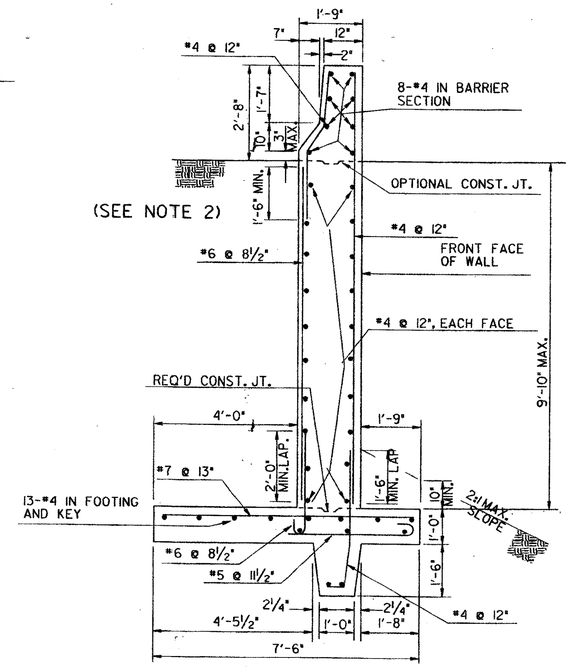

TYPE 2-B SIDE BARRIER

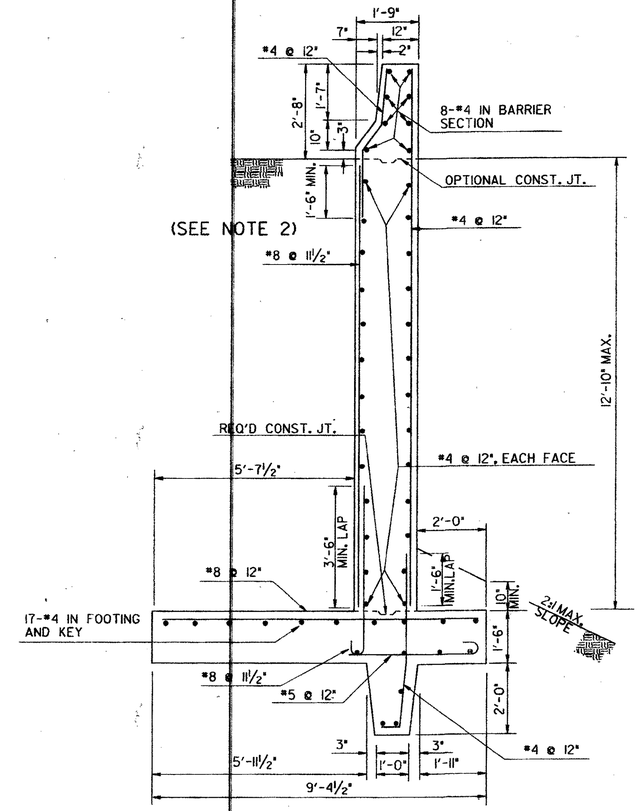

TYPE 2-C SIDE BARRIER

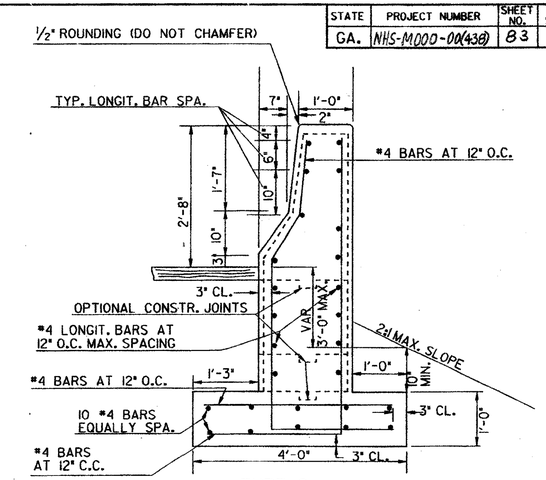

TYPE 2

GENERAL NOTES:

1. AT CONTRACTOR'S OPTION, SIDES OF FOOTING KEY MAY BE VERTICAL. MAINTAIN WIDTH SHOWN AT TOP OF KEY. BACKFILL FRONT FACE OF WALL FIRST.
2. UNDERDRAIN SYSTEM PER DETAILS AT BOTTOM LEFT AND/OR NOTE 9 IS REQUIRED FOR TYPES 2-A, 2-B, AND 2-C.
3. EXPOSED CONCRETE SURFACES SHALL RECEIVE A TYPE III FINISH.
4. 1" EXPANSION JOINTS SHALL BE PROVIDED IN WALL, FOOTING AND KEY AT A MAXIMUM SPACING OF 100 FT. EXPANSION JOINTS SHALL BE SPACED UNIFORMLY.
5. CONTRACTION JOINTS SHALL BE AS SPECIFIED FOR SIDE BARRIER, GA. STD. 4948A.
6. EXPANSION AND CONTRACTION JOINTS IN TYPES 2-A, 2-B, AND 2-C SIDE BARRIER SHALL BE WATERPROOFED ON THE BACK SIDE. WATERPROOFING SHALL BE 3-PLY AND EXTEND FROM TOP OF SAND BLANKET TO TOP OF FOOTING FOR 1'-6" MIN. EACH SIDE OF JOINT.
7. TYPES 2, 2-A, 2-B, AND 2-C SIDE BARRIER SHALL BE PAID FOR PER LIN. FT. AS CONCRETE SIDE BARRIER, TYPE 2, 2A, 2B, OR 2C PRICE BID TO INCLUDE COST OF WATERPROOFING AND ALL INCIDENTALS AS SPECIFIED IN SECTION 621 OF THE STD. SPEC.
8. SIDE BARRIER DESIGNED FOR THE FOLLOWING SOIL PROPERTIES:

   θ = ANGLE OF INTERNAL FRICTION 28°
   γ = UNIT WEIGHT = 110 PCF
   μ = COEFF. OF SLIDING FRICTION = .45

9. A SYNTHETIC DRAINAGE BLANKET SELECTED FROM THE DEPARTMENT'S QUALIFIED PRODUCTS LIST IS AN ACCEPTABLE SUBSTITUTE FOR THE SAND BLANKET, BAG OF STONE, AND MESH SCREEN SHOWN IN THE UNDERDRAIN DETAILS.

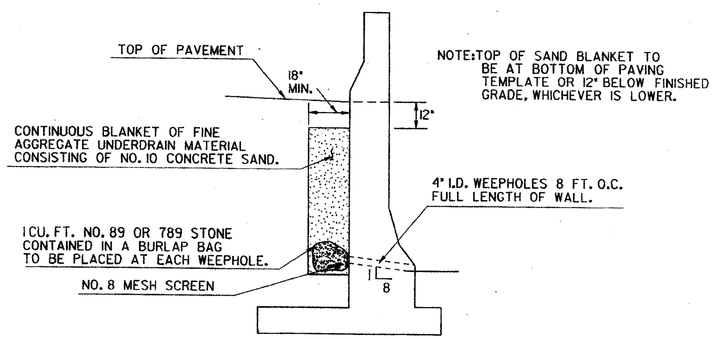

UNDERDRAIN DETAILS

SEE GEN. NOTE 9 FOR ALTERNATE

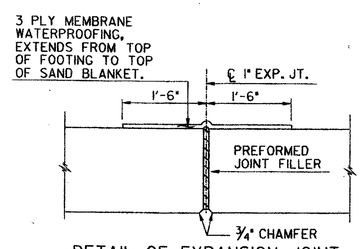

DETAIL OF EXPANSION JOINT

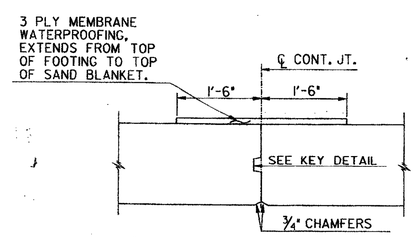

DETAIL OF CONTRACTION JOINT



(FOR USE IN FOOTING AND CONTRACTION JOINT)

SHEAR KEY DETAIL

		DATE	DEPARTMENT OF TRANSPORTATION STATE OF GEORGIA
		REVISION	STANDARD CONCRETE SIDE BARRIER TYPES 2, 2A, 2B & 2C DEC., 1999
		BY	DES. ____ DRW. ____ TRA. ____ CHK. ____ (SUBMITTED) STATE ROAD & AIRPORT DESIGN ENGR. (APPROVED) CHIEF ENGINEER

NUMBER 4948B